


TEMP. CONST. POWER THROUGH MAIN ELECT.-BLDG. SRVC SINGLE FAM. DWELLINGS

**Clark County**  
Dept. of Building & Fire Prevention  
4701 W Russell Rd  
Las Vegas, NV 89118  
(702) 455-3000

**Boulder City**  
Building Department  
401 California Avenue  
Boulder City, NV 89005  
(702) 293-9282

**Henderson**  
Building & Fire Safety Dept.  
240 Water Street  
Henderson, NV 89015  
(702) 267-3650

**Las Vegas**  
Building & Safety Dept.  
333 N. Rancho Drive  
Las Vegas, NV 89106  
(702) 229-6251

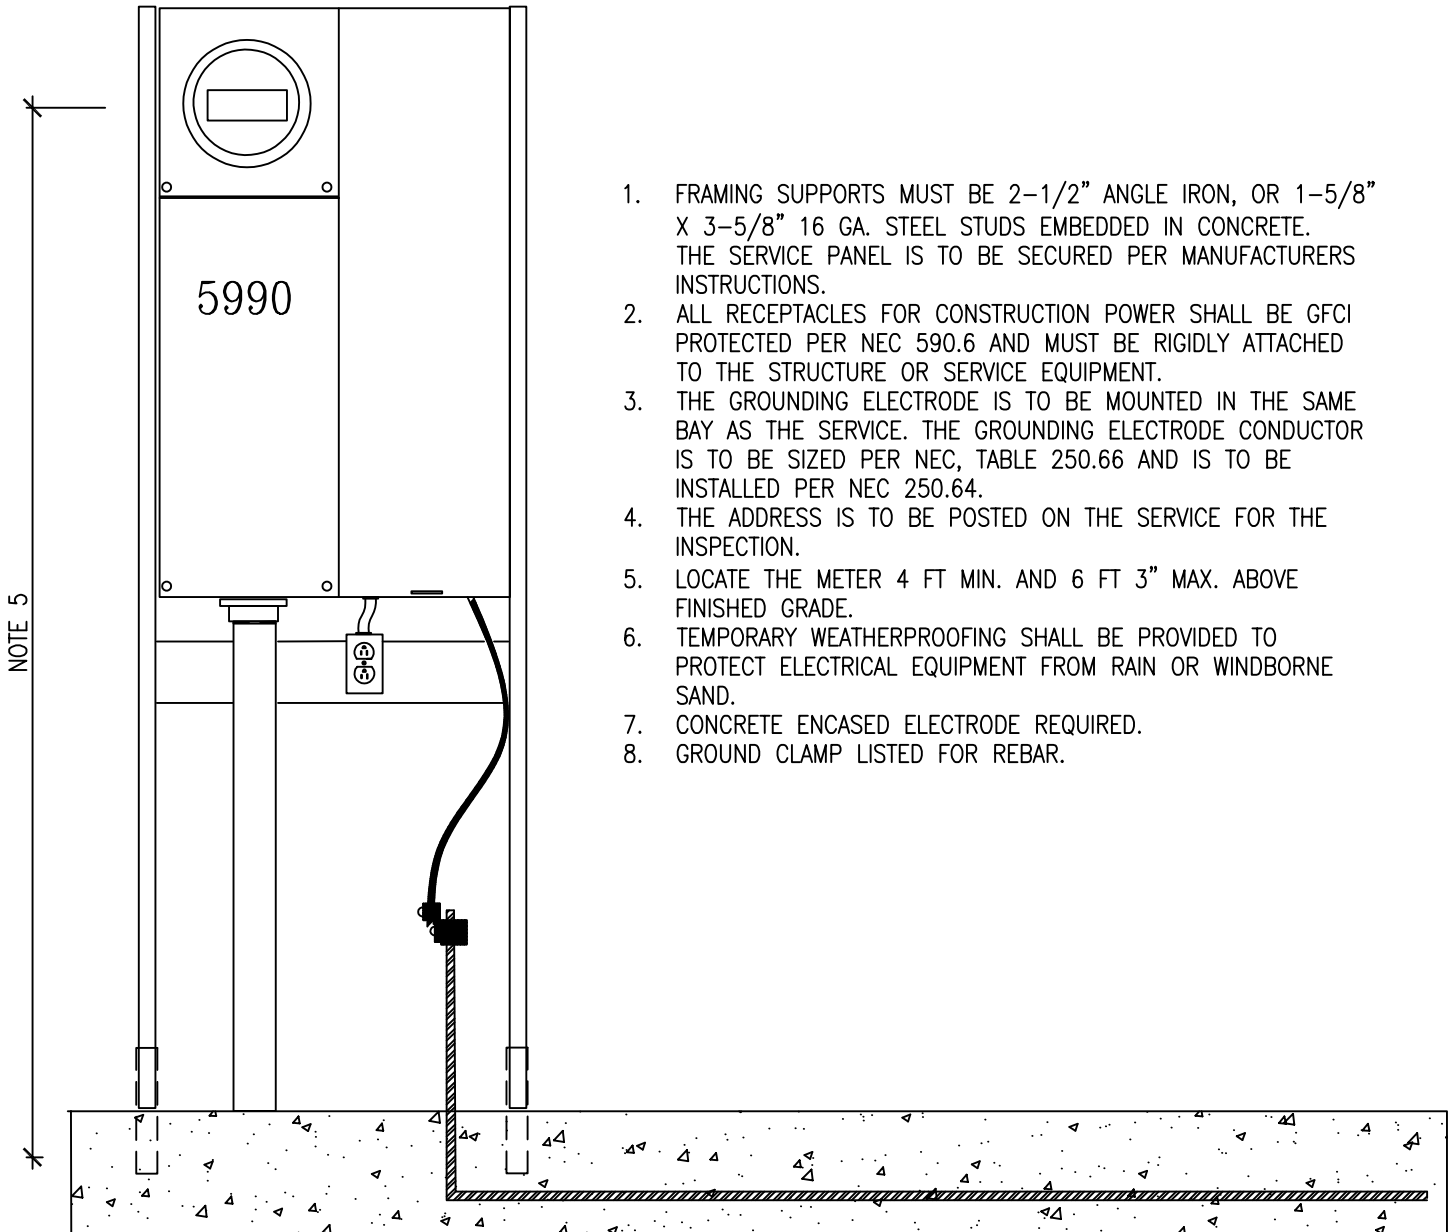

1. FRAMING SUPPORTS MUST BE 2-1/2" ANGLE IRON, OR 1-5/8" X 3-5/8" 16 GA. STEEL STUDS EMBEDDED IN CONCRETE. THE SERVICE PANEL IS TO BE SECURED PER MANUFACTURERS INSTRUCTIONS.
2. ALL RECEPTACLES FOR CONSTRUCTION POWER SHALL BE GFCI PROTECTED PER NEC 590.6 AND MUST BE RIGIDLY ATTACHED TO THE STRUCTURE OR SERVICE EQUIPMENT.
3. THE GROUNDING ELECTRODE IS TO BE MOUNTED IN THE SAME BAY AS THE SERVICE. THE GROUNDING ELECTRODE CONDUCTOR IS TO BE SIZED PER NEC, TABLE 250.66 AND IS TO BE INSTALLED PER NEC 250.64.
4. THE ADDRESS IS TO BE POSTED ON THE SERVICE FOR THE INSPECTION.
5. LOCATE THE METER 4 FT MIN. AND 6 FT 3" MAX. ABOVE FINISHED GRADE.
6. TEMPORARY WEATHERPROOFING SHALL BE PROVIDED TO PROTECT ELECTRICAL EQUIPMENT FROM RAIN OR WINDBORNE SAND.
7. CONCRETE ENCASED ELECTRODE REQUIRED.
8. GROUND CLAMP LISTED FOR REBAR.

**Mesquite**  
Building Department  
10 East Mesquite Blvd.  
Mesquite, NV 89027  
(702) 346-2835

**North Las Vegas**  
Building & Fire Safety  
2250 Las Vegas Blvd. N  
N. Las Vegas, NV 89030  
(702) 633-1577

**Pahrump**  
Building & Fire Safety Dept.  
250 N Hwy 160 Suite #3  
Pahrump, NV 89060  
(775) 751-3373